

Bioclimatic Air Systems

Installation, Operation, & Maintenance Instructions


ELECTRONIC AIR CLEANER

PLEASE READ CAREFULLY **BEFORE** ATTEMPTING INSTALLATION


Congratulations on purchasing an Electronic Air Cleaner, the newest and one of the most efficient ways of reducing indoor air pollution. Used correctly, it will protect the indoor environment from allergy causing pollutants such as pollens, plants, spores, lung damaging particles, tobacco and cooking smoke, fungi, bacteria and some viruses. Many users of Bioclimatic's Electronic Air Cleaners also report a noticeable reduction in airborne odors.

PRODUCT CHECK LIST


- Bioclimatic's Electronic Air Cleaner
- Cord Attachment
- Installation / Maintenance Instructions

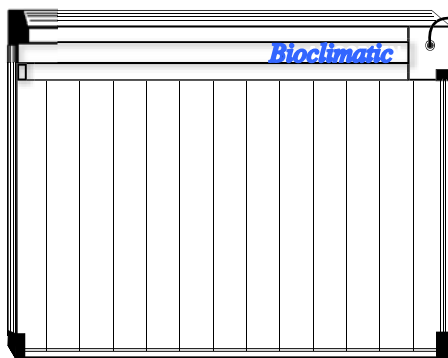

TANDEM CONNECTION
(if required)

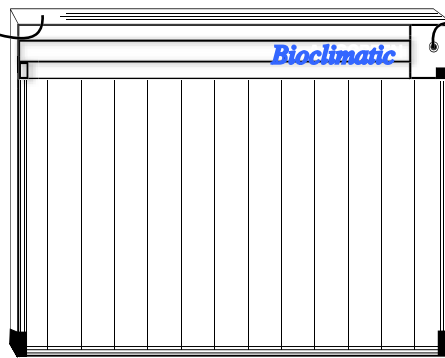

INDIVIDUAL CONNECTION

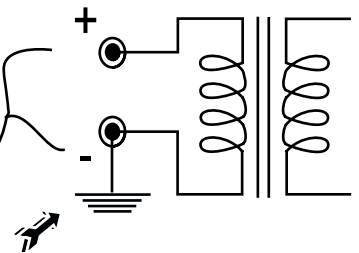

If one terminal of power source is grounded, connect white wire to this terminal.

24 Volt AC power source not supplied

ELECTRICAL HOOKUP

Most forced air heating or cooling systems have an internal 24 Volt AC power source to which the Electronic Air Cleaner can be safely connected. **Before** connecting the Electronic Air Cleaner to this power source, positively identify that it is a 24 Volt (max 30 Volts) AC source. This is usually best accomplished with a test meter.

IMPORTANT

This unit is designed to operate from a supply of 24 Volts AC at 2 VA

DO NOT CONNECT TO 110 VOLTS AC POWER

Connecting the Bioclimatic Electronic Air Cleaner to a higher voltage than specified may cause damage and/or failure of equipment.

110 Volt to 24 volt adapters or transformers are available from Bioclimatic or your local wholesaler.

MAINTENANCE

As the air cleaner operates, the glass fiber pads in the air cleaner will become embedded with dirt. Approximately every 2-3 months, remove the air cleaner from the heating or cooling unit, disconnect the power cord, and vacuum any heavy dust accumulation from the outside screens with a soft brush and wipe clean with a damp cloth. When the time comes to replace the fiber pads, you can contact Bioclimatic or your local distributor for replacement media.

GENERAL NOTES

If the indicator light is not "ON" when the air cleaner is connected, the filter is not working. Check your connections and power source. If these appear correct, contact Bioclimatic's Customer Service. Neither the air cleaner nor the glass fibers can be cleaned by washing or immersing in water. If you wish to clean the frame, disconnect the power cord and wipe gently with a damp cloth. If you experience any difficulties with your Electronic Air Cleaner, call:

CUSTOMER SERVICE
Bioclimatic Air Systems
Tel: 1-800-962-5594
Fax: 1-856-764-4301
Email: info@bioclimatic.com

USE ONLY GENUINE BIOCLIMATIC REPLACEMENT MEDIA

Warranty. SELLER WARRANTS THE EQUIPMENT AGAINST DEFECTIVE WORKMANSHIP AND MATERIAL FOR ONE (1) YEAR FROM DATE OF FACTORY SHIPMENT. IN THE FULFILLMENT OF ITS WARRANTY, THE SOLE OBLIGATION OF SELLER SHALL BE TO REPAIR OR REPLACE, AT ITS OPTION, F.O.B. ITS FACTORY, ANY PART OR PARTS WHICH ARE RETURNED F.O.B. ITS FACTORY, SHIPPING CHARGES PREPAID, AND WHICH AFTER INSPECTION BY SELLER ARE FOUND TO BE DEFECTIVE. BUYER SHALL NOTIFY SELLER OF DEFECT IN WRITING, PROMPTLY UPON DISCOVERY AND WITHIN THE WARRANTY PERIOD. THIS WARRANTY DOES NOT COVER DEFECTS CAUSED BY CORROSION OR NORMAL DETERIORATION; IT DOES NOT EXTEND TO CONSEQUENTIAL DAMAGE, LOSS OR DELAY ASSOCIATED WITH A WARRANTY DEFECT; AND IT DOES NOT COVER ANY COST OF LABOR, TRAVEL, OR OTHER EXPENSE ASSOCIATED WITH THE REPAIR OR REPLACEMENT OF DEFECTIVE PARTS. SELLER ASSUMES NO LIABILITY FOR PRODUCT LOSS OR OTHER CLAIMS WHATSOEVER ARISING OUT OF THE USE OR APPLICATION OF THE EQUIPMENT IN ANY OPERATIONS, WHETHER THE MACHINE IS USED ALONE OR IN CONJOINT USE WITH OTHER EQUIPMENT OR PROCESSES. THIS WARRANTY IS VOIDED IF REPAIRS, REPLACEMENTS, OR ALTERATIONS ARE MADE BY OTHERS WITHOUT PRIOR AUTHORIZATION BY SELLER. NOTWITHSTANDING THE FOREGOING, SELLER'S WARRANTY OBLIGATIONS WITH RESPECT TO ANY ITEMS NOT MANUFACTURED BY SELLER SHALL NOT EXCEED THE OBLIGATIONS UNDERTAKEN BY THE MANUFACTURER THEREOF UNDER EXPRESS WARRANTY TO THE SELLER. THIS EXPRESS WARRANTY IS IN LIEU OF ALL OTHER WARRANTIES OF FITNESS OF THE MACHINE FOR ANY PARTICULAR PURPOSE.

WARRANTY REGISTRATION

NAME: _____

ADDRESS: _____

CITY: _____ STATE / PROV: _____

ZIP / POSTAL CODE: _____

TELEPHONE: _____ FAX: _____ E-MAIL: _____

PURCHASED FROM: _____ DATE PURCHASED: _____ SIZE _____

TO RECEIVE ADDITIONAL INFORMATION ON THIS OR OTHER BIOCLIMATIC PRODUCTS PLEASE CHECK HERE:

Bioclimatic Air Systems

600 Delran Parkway
Delran, NJ 08075 USA

1-856-764-4300 (P)

1-856-764-4301 (F)

Web: www.bioclimatic.com

